


GATE LOCATION
SCALE: NTS



NOTES:

1. INSTALLATION OF GATES REQUIRES PRIOR CAL FIRE APPROVAL.
2. INSTALLATION OF GATES MAY REQUIRE A BUILDING PERMIT ISSUED BY THE COUNTY PLANNING AND BUILDING DEPARTMENT. CONTACT 805/781-5200 FOR ADDITIONAL INFORMATION.
3. ALL LOCKED GATES MUST BE EQUIP WITH A CAL FIRE APPROVED KNOX BOX PRODUCT PER STD 5A
4. CLEAR WIDTH WITH GATE FULLY OPEN MUST BE NO LESS THAN THE WIDTH OF THE ACCESS ROAD OR DRIVEWAY PLUS TWO (2) FEET EACH SIDE, AND IN NO CASE BE LESS THAT 14-FEET WIDE.
5. FOR GATES LOCATED OFF PUBLIC ROADS THE APPLICANT MUST ALSO OBTAIN PRIOR APPROVAL FROM COUNTY PUBLIC WORKS.
6. MINIMUM SETBACK REQUIREMENTS AS FOLLOWS:
 - A. FIRE CODE: GATES MUST BE SET BACK A MINIMUM OF 30-FEET FROM THE NEAREST INTERSECTING ROAD.
 - B. COUNTY PUBLIC WORKS: MAY REQUIRE GATES TO BE SETBACK A MINIMUM OF 75-FEET FROM THE NEAREST INTERSECTING PUBLIC ROAD FOR COMMERCIAL AND AGRICULTURAL LAND USES.

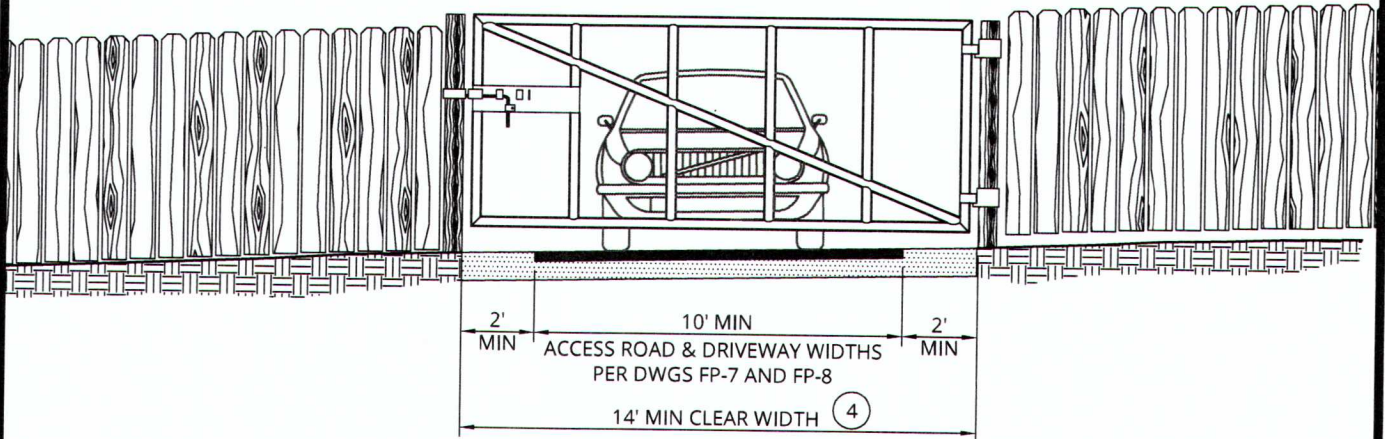

COUNTY OF SAN LUIS OBISPO FIRE DEPARTMENT / CAL FIRE
DRIVEWAY & ACCESS ROAD GATE

Adopted: Aug. 2014	Scale: 1"=5'
Revised: Apr. 2017	Revision No.: 1
Drawing No.:	FP-5