


POLY TANKS ALLOWABLE IN MODERATE FIRE HAZARD SEVERITY ZONES ONLY  
 STEEL TANK REQUIRED IN HIGH AND VERY HIGH FIRE HAZARD SEVERITY ZONES

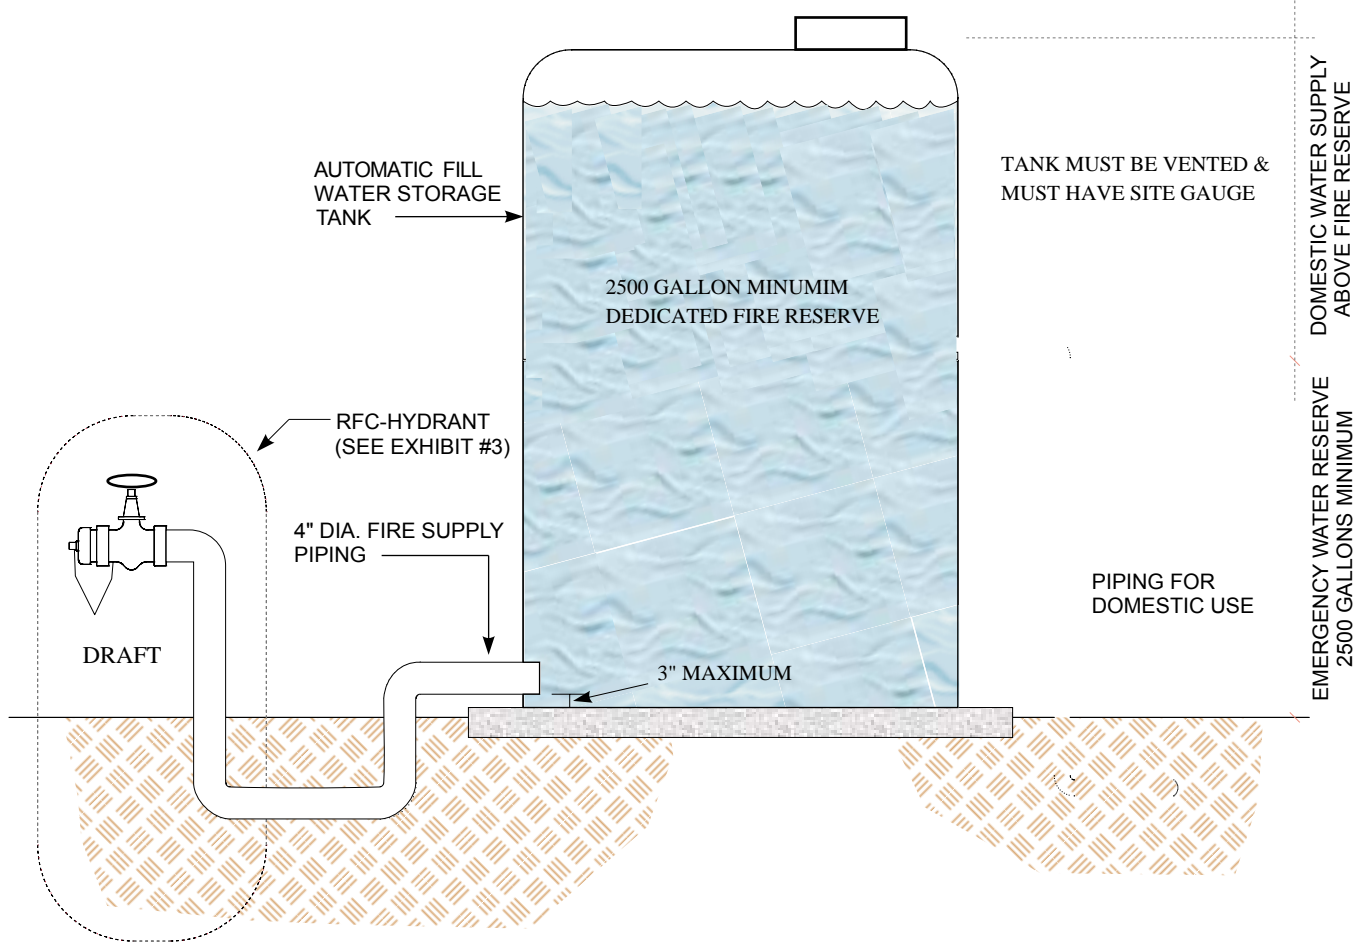

FOR STORAGE CAPACITY REQUIREMENTS, REFER TO WATER STANDARD #1  
 WHEN MULTIPLE TANKS ARE UTILIZED TO ACHIEVE THE REQUIRED VOLUME  
 OF WATER, THE CONNECTION BETWEEN THE TANKS SHALL BE BY AN APPROVED  
 4" DIAMETER WATER LINE

**EMERGENCY WATER SUPPLY**

**CAL FIRE/SLO COUNTY FIRE DEPARTMENT  
 FIRE PREVENTION**

635 N. Santa Rosa Avenue  
 San Luis Obispo, California 93405  
 Telephone (805) 543-4244 Fax (805) 543-4248

**FIRE SAFE EXHIBIT**

NOT TO SCALE

SCALE

**2**

August 2011

EXHIBIT NO.