


POLY TANKS ALLOWABLE IN MODERATE FIRE HAZARD SEVERITY ZONES ONLY
 STEEL TANK REQUIRED IN HIGH AND VERY HIGH FIRE HAZARD SEVERITY ZONES

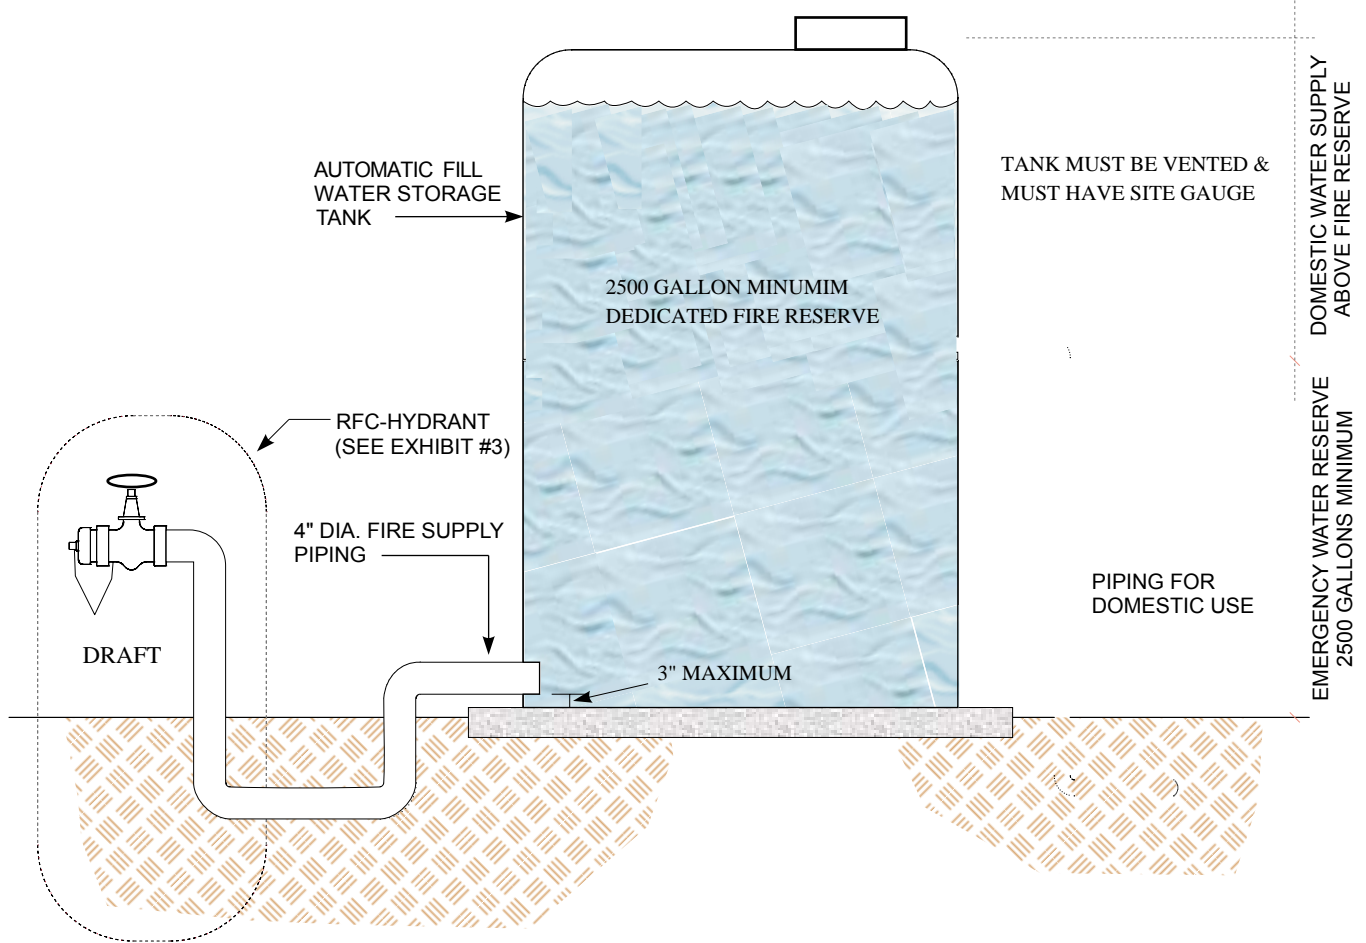

FOR STORAGE CAPACITY REQUIREMENTS, REFER TO WATER STANDARD #1
 WHEN MULTIPLE TANKS ARE UTILIZED TO ACHIEVE THE REQUIRED VOLUME
 OF WATER, THE CONNECTION BETWEEN THE TANKS SHALL BE BY AN APPROVED
 4" DIAMETER WATER LINE

EMERGENCY WATER SUPPLY

**CAL FIRE/SLO COUNTY FIRE DEPARTMENT
 FIRE PREVENTION**

635 N. Santa Rosa Avenue
 San Luis Obispo, California 93405
 Telephone (805) 543-4244 Fax (805) 543-4248

FIRE SAFE EXHIBIT

NOT TO SCALE

SCALE

2

August 2011

EXHIBIT NO.