

SRA FIRE SAFE REGULATIONS

2020

**14 CCR, Division 1.5, Chapter 7 Fire Protection,
Subchapter 2, Articles
1-5. SRA Fire Safe Regulations**



SAN LUIS OBISPO COUNTY FIRE

CAL FIRE

**Development in San Luis Obispo County Fire / CAL
FIRE Responsibility areas**

Table of Contents

PURPOSE..... 2
LIST OF TITLE 14 SECTIONS 4
ADMINISTRATION 5
 Definitions 8
EMERGENCY ACCESS AND EGRESS..... 10
 Width..... 11
 Surfaces..... 11
 Grades 12
 Radius..... 12
 Turnarounds..... 12
 Turnouts..... 14
 Road and Driveway Structures 14
 Dead-end Roads..... 14
 Gate Entrances 15
SIGNING AND BUILDING NUMBERING 15
 Intent..... 15
 Road Signs 15
 Road Sign Installation, Location, and Visibility 15
 Addresses for Buildings 16
 Address Installation, Location, and Visibility 16
EMERGENCY WATER STANDARDS..... 16
 Intent..... 17
 Application 17
 Water Supply 17
 Hydrant/Fire Valve 17
 Signing of Water Sources 17
FUEL MODIFICATION STANDARDS 18
 Intent..... 18
 Setback for Structure Defensible Space 18
 Maintenance of Defensible Space Measures 18
 Disposal of Flammable Vegetation and Fuels..... 18
 Greenbelts 19
SECONDARY EGRESS STANDARD 19

January 1, 2020

Development in San Luis Obispo County Fire / CAL FIRE Responsibility areas

Purpose

These regulations apply to all areas in San Luis Obispo County Fire's jurisdiction (SRA). Title 14 applies to all projects including new building construction permits, remodels, change in occupancy, code violation permits and applications for use permits. The regulations are established to ensure the minimum wildfire protection standards in conjunction with building construction and development are being met. San Luis Obispo County Fire has adopted more stringent regulations through the adoption of local fire codes and ordinances. Local fire code amendments are identified throughout the guideline. In the event of conflicting codes the more stringent will apply.

It is the responsibility of the design professional, owner or their representative to ensure the requirements of the Fire Code, local amendments and Title 14 requirements are being met.

CONTACT INFORMATION

CAL FIRE / SLU
Fire Marshal's Office

635 N. Santa Rosa
San Luis Obispo CA 93405

805-543-4244

CALIFORNIA BOARD OF FORESTRY AND FIRE PROTECTION
SRA FIRE SAFE REGULATIONS



As of January 1, 2020
California Code of Regulations
Title 14 Natural Resources
Division 1.5 Department of Forestry
Chapter 7 - Fire Protection
Subchapter 2 SRA Fire Safe Regulations
Article 1 | Article 2 | Article 3 | Article 4 | Article 5 | Index

LIST OF TITLE 14 SECTIONS

ARTICLE 1. ADMINISTRATION

- § 1270.00. Title
- § 1270.01. Purpose
- § 1270.02. Scope
- § 1270.03. Provisions for Application of These Regulations
- § 1270.04. Local Ordinances
- § 1270.05. Inspections
- § 1270.06. Exceptions to Standards
- § 1271.00. Definitions

ARTICLE 2. EMERGENCY ACCESS AND EGRESS

- § 1273.00. Intent
- § 1273.01. Width
- § 1273.02. Road Surfaces
- § 1273.03. Grades
- § 1273.04. Radius
- § 1273.05. Turnarounds
- § 1273.06. Turnouts
- § 1273.07. Road and Driveway Structures
- § 1273.08. Dead-end Roads
- § 1273.09. Gate Entrances

ARTICLE 3. SIGNING AND BUILDING NUMBERING

- § 1274.00. Intent
- § 1274.01. Road Signs
- § 1274.02. Road Sign Installation, Location, and Visibility
- § 1274.03. Addresses for Buildings
- § 1274.04. Address Installation, Location, and Visibility

ARTICLE 4. EMERGENCY WATER STANDARDS

- § 1275.00. Intent
- § 1275.01. Application
- § 1275.02. Water Supply
- § 1275.03. Hydrant/Fire Valve
- § 1275.04. Signing of Water Sources

ARTICLE 5. FUEL MODIFICATION STANDARDS

- § 1276.00. Intent
- § 1276.01. Setback for Structure Defensible Space
- § 1276.02. Maintenance of Defensible Space Measures
- § 1276.03. Disposal of Flammable Vegetation and Fuels
- § 1276.04. Greenbelts

ARTICLE 1. ADMINISTRATION

- § 1270.00. Title
- § 1270.01. Purpose
- § 1270.02. Scope
- § 1270.03. Provisions for Application of These Regulations
- § 1270.04. Local Ordinances
- § 1270.05. Inspections
- § 1270.06. Exceptions to Standards
- § 1271.00. Definitions

1270.00. Title

These regulations shall be known as “SRA Fire Safe Regulations,” and shall constitute the basic wildfire protection standards of the California Board of Forestry and Fire Protection.

1270.01. Purpose

- (a) These regulations have been prepared and adopted for the purpose of establishing minimum wildfire protection standards in conjunction with building, construction and development in the State Responsibility Area (SRA).
- (b) The future design and construction of structures, subdivisions and developments in SRA shall provide for basic emergency access and perimeter wildfire protection measures as specified in the following articles.
- (c) These measures shall provide for emergency access; signing and building numbering; private water supply reserves for emergency fire use; and vegetation modification. The fire protection standards which follow shall specify the minimums for such measures.

1270.02. Scope

- (a) These regulations shall apply to:
 - (1) the perimeters and access to all residential, commercial, and industrial building construction within the SRA approved after January 1, 1991 except as set forth below in subsection (b);
 - (2) the siting of newly installed commercial modular, manufactured homes, mobilehomes, and factory-built housing, as defined in Health and Safety Code section 18001.8, 18007, 18008, and 19971;
 - (3) all tentative and parcel maps or other developments approved after January 1, 1991; and
 - (4) applications for building permits on a parcel approved in a pre-1991 parcel or tentative map to the extent that conditions relating to the perimeters and access to the buildings were not imposed as part of the approval of the parcel or tentative map.
- (b) These regulations do not apply where an application for a building permit is filed after January 1, 1991 for building construction on a parcel that was formed from a parcel map or tentative map (if the final map for the tentative map is approved within the time prescribed by the local ordinance) approved prior to January 1, 1991, to the extent that conditions relating to the perimeters and access to the buildings were imposed by the parcel map or final tentative map approved prior to January 1, 1991.

- (c) Affected activities include, but are not limited to:
- (1) permitting or approval of new parcels, excluding lot line adjustments as specified in Government Code (GC) section 66412(d);
 - (2) application for a building permit for new construction, not relating to an existing structure;
 - (3) application for a use permit;
 - (4) road construction, including construction of a road that does not currently exist, or extension of an existing road.
- (d) EXEMPTION: Roads used solely for agricultural, mining, or the management and harvesting of wood products.

1270.03. Provisions for Application of these Regulations

This subchapter shall be applied as follows:

- (a) local jurisdictions shall provide the Director of the California Department of Forestry and Fire Protection (CAL FIRE) or their designee with notice of applications for building permits, tentative parcel maps, tentative maps, and installation or use permits for construction or development within SRA.
- (b) the Director or their designee may review and make fire protection recommendations on applicable construction or development or maps provided by the local jurisdiction.
- (c) the local jurisdiction shall ensure that the applicable sections of this subchapter become a condition of approval of any applicable construction or development permit or map.

1270.04. Local Ordinances

- (a) Nothing contained in these regulations shall be considered as abrogating the provisions of any ordinance, rule or regulation of any state or local jurisdiction providing such ordinance, rule, regulation or general plan element is equal to or more stringent than these minimum standards.
- (b) The Board may certify local ordinances as equaling or exceeding these regulations when they provide the same practical effect.
- (c) Counties may submit their local ordinances for certification via email to the Board.
- (d) The Board's certification of local ordinances pursuant to this section is rendered invalid when previously certified ordinances are subsequently amended by local jurisdictions without Board re-certification of the amended ordinances. The Board's regulations supersede the amended local ordinance(s) when the amended local ordinance(s) are not re-certified by the Board. Amendments made by local jurisdictions to previously certified ordinances shall be submitted for re-certification.

1270.05. Inspection Authority

Inspections shall conform to the following requirements:

- (a) Inspection shall be made by:
 - (1) the Director, or
 - (2) local jurisdictions that have assumed state fire protection responsibility on SRA lands, or
 - (3) local jurisdictions where the inspection duties have been formally delegated by CAL FIRE to the local jurisdiction.

(b) Inspections made under 14 CCR § 1270.05(a)(2) or 14 CCR § 1270.05(a)(3) shall only occur when these regulations are to be incorporated into local ordinance in one of the following manners:

- (1) these regulations have been incorporated verbatim or by reference into that jurisdiction's permitting or approval process for the activities described in 14 CCR Section 1270.02; or
- (2) the local ordinances have been certified pursuant to 14 CCR § 1270.04.

(c) Nothing in this section abrogates CAL FIRE's authority to inspect and enforce state forest and fire laws even when the inspection duties have been delegated pursuant to this section.

(d) Reports of violations shall be provided to the CAL FIRE Unit headquarters that administers SRA fire protection in the local jurisdiction.

(e) When inspections are conducted, they shall occur prior to: the issuance of the use permit or certificate of occupancy; the recordation of the parcel map or final map; the filing of a notice of completion; or the final inspection of any project or building permit.

1270.06. Exceptions to Standards

(a) Upon request by the applicant, exceptions to standards within this subchapter or local jurisdiction certified ordinances may be allowed by the inspection entity listed in 14 CCR § 1270.05, where the exceptions provide the same overall practical effect as these regulations towards providing defensible space. Exceptions granted by the inspection entity listed in 14 CCR § 1270.05 shall be made on a case-by-case basis only. Exceptions granted by the inspection entity listed in 14 CCR § 1270.05 shall be forwarded to the appropriate CAL FIRE Unit Office that administers SRA fire protection in that county and shall be retained on file at the Unit Office.

(b) Requests for an exception shall be made in writing to the inspection entity listed in 14 CCR § 1270.05 by the applicant or the applicant's authorized representative. At a minimum, the request shall state the specific section(s) for which an exception is requested, material facts supporting the contention of the applicant, the details of the exception proposed, and a map showing the proposed location and siting of the exception. Jurisdictions may establish additional procedures or requirements for exception requests.

(c) Where an exception is not granted by the inspection authority, the applicant may appeal such denial to the local jurisdiction. The local jurisdiction may establish or utilize an appeal process consistent with existing local building or planning department appeal processes.

(d) Before the local jurisdiction makes a determination on an appeal, the inspection authority shall be consulted and shall provide to that local jurisdiction documentation outlining the effects of the requested exception on wildland fire protection.

(e) If an appeal is granted, the local jurisdiction shall make findings that the decision meets the intent of providing defensible space consistent with these regulations. Such findings shall include a statement of reasons for the decision. A written copy of these findings shall be provided to the CAL FIRE Unit headquarters that administers SRA fire protection in that local jurisdiction.

1271.00. Definitions

Agriculture: Land used for agricultural purposes as defined in a local jurisdiction's zoning ordinances.

Building: Any structure used or intended for supporting or sheltering any use or occupancy, except Utility and Miscellaneous Group U buildings.

CAL FIRE: California Department of Forestry and Fire Protection.

Dead-end road: A road that has only one point of vehicular ingress/egress, including cul-de-sacs and looped roads.

Defensible space: The area within the perimeter of a parcel, development, neighborhood or community where basic wildland fire protection practices and measures are implemented, providing the key point of defense from an approaching wildfire or defense against encroaching wildfires or escaping structure fires. The perimeter as used in this regulation is the area encompassing the parcel or parcels proposed for construction and/or development, excluding the physical structure itself. The area is characterized by the establishment and maintenance of emergency vehicle access, emergency water reserves, street names and building identification, and fuel modification measures.

Development: As defined in Section 66418.1 of the California Government Code.

Director: Director of the Department of Forestry and Fire Protection or their designee.

Driveway: A vehicular access that serves up to two (2) parcels with no more than two (2) residential units and any number of non-commercial or industrial buildings on each parcel.

Distance Measurements: All specified or referenced distances are measured along the ground, unless otherwise stated.

Exception: An alternative to the specified standard requested by the applicant that may be necessary due to health, safety, environmental conditions, physical site limitations or other limiting conditions such as recorded historical sites, that provide mitigation of the problem.

Fire valve: See hydrant.

Fuel modification area: An area where the volume of flammable vegetation has been reduced, providing reduced fire intensity and duration.

Greenbelts: A facility or land-use, designed for a use other than fire protection, which will slow or resist the spread of a wildfire. Includes parking lots, irrigated or landscaped areas,

golf courses, parks, playgrounds, maintained vineyards, orchards or annual crops that do not cure in the field.

Hammerhead/T: A road or driveway that provides a "T" shaped, three-point turnaround space for emergency equipment, being no narrower than the road that serves it.

Hydrant: A valved connection on a water supply or storage system, having either one two and a half (2 ½) inch or one four and a half (4 ½) inch outlet, with male American National Fire Hose Screw Threads (NH) used to supply fire apparatus and hoses with water.

Local Jurisdiction: Any county, city/county agency or department, or any locally authorized district that issues or approves building permits, use permits, tentative maps or tentative parcel maps, or has authority to regulate development and construction activity.

Occupancy: The purpose for which a building, or part thereof, is used or intended to be used.

One-way road: A minimum of one traffic lane width designed for traffic flow in one direction only.

Residential unit: Any building or portion thereof which contains living facilities, including provisions for sleeping, eating, cooking and/or sanitation for one or more persons. Manufactured homes, mobilehomes, and factory-built housing are considered residential units for purposes of mandatory measures required in Section § 1270.01(c).

Road: Vehicular access to more than two (2) parcels; more than four (4) residential units; or access to any industrial or commercial occupancy. Includes public and private streets and lanes.

Road or driveway structures: Bridges, culverts, and other appurtenant structures which supplement the traffic lane or shoulders.

Same Practical Effect: As used in this subchapter means an exception or alternative with the capability of applying accepted wildland fire suppression strategies and tactics, and provisions for fire fighter safety, including:

- (a) access for emergency wildland fire equipment,
- (b) safe civilian evacuation,
- (c) signing that avoids delays in emergency equipment response,
- (d) available and accessible water to effectively attack wildfire or defend a structure from wildfire, and
- (e) fuel modification sufficient for civilian and fire fighter safety.

Shoulder: Vehicular access adjacent to the traffic lane.

State Board of Forestry and Fire Protection (Board): As defined in Public Resources Code section 730.

State Responsibility Area (SRA): As defined in the Public Resources Code section 4126-4127; and the California Code of Regulations, Title 14, Division 1.5, Chapter 7, Article 1, Sections 1220-1220.5.

Structure: That which is built or constructed, an edifice or building of any kind, or any piece of work artificially built up or composed of parts joined together in some definite manner.

Subdivision: As defined in Section 66424 of the Government Code.

Traffic lane: The portion of a road or driveway that provides a single line of vehicle travel.

Turnaround: A road or driveway, unobstructed by parking, which allows for a safe opposite change of direction for emergency equipment. Design of such area may be a hammerhead/T or terminus bulb.

Turnouts: A widening in a road or driveway to allow vehicles to pass.

Utility and Miscellaneous Group U buildings: A structure of an accessory character or a miscellaneous structure not classified in any specific occupancy permitted, constructed, equipped, and maintained to conform to the requirements of Title 24, California Building Standards Code.

Vertical clearance: The minimum specified height of a bridge or overhead projection above the road or driveway.

Wildfire: As defined in Public Resources Code Section 4103 and 4104.

ARTICLE 2. EMERGENCY ACCESS AND EGRESS

- § 1273.00. Intent
- § 1273.01. Width
- § 1273.02. Road Surfaces
- § 1273.03. Grades
- § 1273.04. Radius
- § 1273.05. Turnarounds
- § 1273.06. Turnouts
- § 1273.07. Road and Driveway Structures
- § 1273.08. Dead-end Roads
- § 1273.09. Gate Entrances

1273.00. Intent

Roads and driveways, whether public or private, unless exempted under 14 CCR §1270.02(d), shall provide for safe access for emergency wildfire equipment and civilian evacuation concurrently, and shall provide unobstructed traffic circulation during a wildfire emergency consistent with 14 CCR §§ 1273.00 through 1273.09.

1273.01. Width

(a) All roads shall be constructed to provide a minimum of two ten (10) foot traffic lanes, not including shoulder and striping. These traffic lanes shall provide for two-way traffic flow to support emergency vehicle and civilian egress, unless other standards are provided in this article, or additional requirements are mandated by local jurisdictions or local subdivision requirements. Vertical clearances shall conform to the requirements in California Vehicle Code section 35250.

(b) All one-way roads shall be constructed to provide a minimum of one twelve (12) foot traffic lane, not including shoulders. The local jurisdiction may approve one-way roads.

(1) All one-way roads shall connect to a road with two traffic lanes at both ends, and shall provide access to an area currently zoned for no more than ten (10) residential units.

(2) In no case shall a one-way road exceed 2,640 feet in length. A turnout shall be placed and constructed at approximately the midpoint of each one-way road.

(3) All driveways shall be constructed to provide a minimum of one (1) ten (10) foot traffic lane, fourteen (14) feet unobstructed horizontal clearance, and unobstructed vertical clearance of thirteen feet, six inches (13'6").

San Luis Obispo County Title 16:Driveway widths:

- **12 feet wide** - driveways 0 - 199 feet in length
- **14 feet wide** - driveways greater than 200 feet in length.

Commercial widths: (required for all roads serving more than 2 parcels or more than 4 residential units, or any commercial occupancy).

- **20 feet wide** with 2 feet of shoulders on either side.

One way widths:

- **16 feet** - commercial

1273.02. Surfaces

(a) Roads shall be designed and maintained to support the imposed load of fire apparatus weighing at least 75,000 pounds and provide an aggregate base.

(b) Driveways and road and driveway structures shall be designed and maintained to support at least 40,000 pounds.

(c) Project proponent shall provide engineering specifications to support design, if requested by the local authority having jurisdiction.

San Luis Obispo County Title 22:Surface:

- less than 12% - all weather
- greater than 12% - Non-skid¹

¹surfacing shall be asphalt or concrete specified in San Luis Obispo County Standard.

1273.03. Grades

- (a) At no point shall the grade for all roads and driveways exceed 16 percent.
- (b) The grade may exceed 16%, not to exceed 20%, with approval from the local authority having jurisdiction and with mitigations to provide for the same practical effect.

Approved Grades over 20%:

- Maximum allowable grades are permitted for distances no greater than 300 ft. At the beginning and end of each section 100 ft. of less than 10% is required.

San Luis Obispo County Title 16:**Special Purpose Road:**

- Roads designed to service non-habitable infrastructure to include communication towers, water tanks, etc.
- 12 feet wide - roads exceeding 150 feet turnout required at the midpoint and turnaround within 50 feet of infrastructure.


1273.04. Radius

- (a) No road or road structures shall have a horizontal inside radius of curvature of less than fifty (50) feet. An additional surface width of four (4) feet shall be added to curves of 50-100 feet radius; two (2) feet to those from 100-200 feet.
- (b) The length of vertical curves in roads, exclusive of gutters, ditches, and drainage structures designed to hold or divert water, shall be not less than one hundred (100) feet.


1273.05. Turnarounds

- (a) Turnarounds are required on driveways and dead-end roads.
- (b) The minimum turning radius for a turnaround shall be forty (40) feet, not including parking, in accordance with the figures in 14 CCR §§ 1273.05(e) and 1273.05(f). If a hammerhead/T is used instead, the top of the "T" shall be a minimum of sixty (60) feet in length.
- (c) Driveways exceeding 150 feet in length, but less than 800 feet in length, shall provide a turnout near the midpoint of the driveway. Where the driveway exceeds 800 feet, turnouts shall be provided no more than 400 feet apart.
- (d) A turnaround shall be provided on driveways over 300 feet in length, and shall be within fifty (50) feet of the building.
- (e) Each dead-end road shall have a turnaround constructed at its terminus. Where parcels are zoned five (5) acres or larger, turnaround shall be provided at a maximum of 1,320 foot intervals.

(d) Figure A. Turnarounds on roads with two (2) ten-foot traffic lanes.

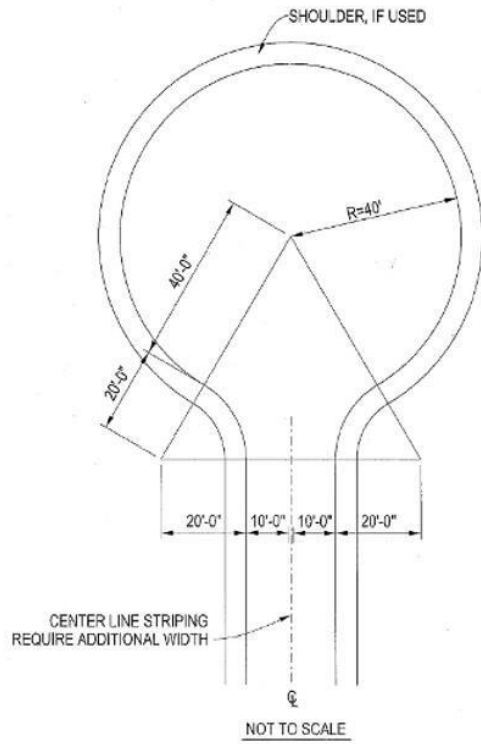

(e) Figure B. Turnarounds on driveways with one (1) ten-foot traffic lane.

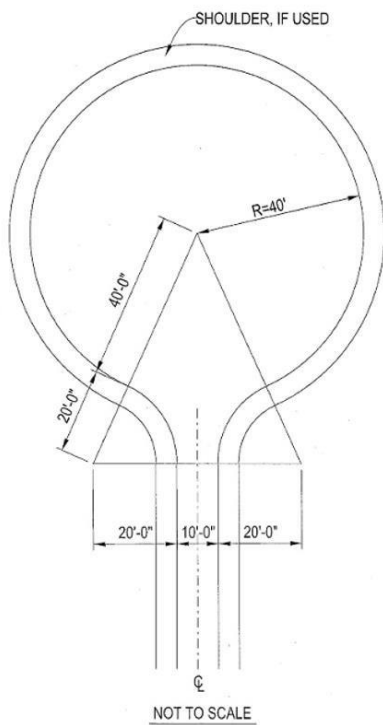

1273.06. Turnouts

Turnouts shall be a minimum of twelve (12) feet wide and thirty (30) feet long with a minimum twenty-five (25) foot taper on each end.

1273.07. Road and Driveway Structures

(a) Appropriate signing, including but not limited to weight or vertical clearance limitations, one-way road or single traffic lane conditions, shall reflect the capability of each bridge.

(b) Where a bridge or an elevated surface is part of a fire apparatus access road, the bridge shall be constructed and maintained in accordance with the American Association of State and Highway Transportation Officials Standard Specifications for Highway Bridges, 17th Edition, published 2002 (known as AASHTO HB-17), hereby incorporated by reference. Bridges and elevated surfaces shall be designed for a live load sufficient to carry the imposed loads of fire apparatus. Vehicle load limits shall be posted at both entrances to bridges when required by the local authority having jurisdiction.

(c) Where elevated surfaces designed for emergency vehicle use are adjacent to surfaces which are not designed for such use, barriers, or signs, or both, as approved by the local authority having jurisdiction, shall be installed and maintained.

(d) A bridge with only one traffic lane may be authorized by the local jurisdiction; however, it shall provide for unobstructed visibility from one end to the other and turnouts at both ends.

1273.08. Dead-End Roads

(a) The maximum length of a dead-end road, including all dead-end roads accessed from the dead-end road, shall not exceed the following cumulative lengths, regardless of the numbers of parcels served:

parcels zoned for less than one acre – 800 feet

parcels zoned for 1 acre to 4.99 acres – 1320 feet

parcels zoned for 5 acres to 19.99 acres – 2640 feet

parcels zoned for 20 acres or larger – 5280 feet

All lengths shall be measured from the edge of the road surface at the intersection that begins the road to the end of the road surface at its farthest point. Where a dead-end road crosses areas of differing zoned parcel sizes requiring different length limits, the shortest allowable length shall apply.

(b) See 14 CCR § 1273.05 for dead-end road turnaround requirements.

San Luis Obispo County Title 16:

- Roads exceeding the maximum dead-end lengths require secondary egress determined by the fire code official.

1273.09. Gate Entrance

(a) Gate entrances shall be at least two (2) feet wider than the width of the traffic lane(s) serving that gate and a minimum width of fourteen (14) feet unobstructed horizontal clearance and unobstructed vertical clearance of thirteen feet, six inches (13'6").

(b) All gates providing access from a road to a driveway shall be located at least thirty (30) feet from the roadway and shall open to allow a vehicle to stop without obstructing traffic on that road.

(c) Where a one-way road with a single traffic lane provides access to a gated entrance, a forty (40) foot turning radius shall be used.

(d) Security gates shall not be installed without approval and where security gates are installed, they shall have an approved means of emergency operation. Approval shall be by the local authority having jurisdiction. The security gates and the emergency operation shall be maintained operational at all times.

ARTICLE 3. SIGNING AND BUILDING NUMBERING

§ 1274.00. Intent

§ 1274.01. Road Signs

§ 1274.02. Road Sign Installation, Location, and Visibility

§ 1274.03. Addresses for Buildings

§ 1274.04. Address Installation, Location, and Visibility

1274.00. Intent

To facilitate locating a fire and to avoid delays in response, all newly constructed or approved roads and buildings shall be designated by names or numbers posted on signs clearly visible and legible from the road. This section shall not restrict the size of letters of numbers appearing on road signs for other purposes.

1274.01. Roads Signs

(a) Newly constructed or approved roads must be identified by a name or number through a consistent system that provides for sequenced or patterned numbering and/or non-duplicative naming within each local jurisdiction. This section does not require any entity to rename or renumber existing roads, nor shall a road providing access only to a single commercial or industrial occupancy require naming or numbering.

(b) The size of letters, numbers, and symbols for road signs shall be a minimum four (4) inch letter height, half (.5) inch stroke, reflectorized, contrasting with the background color of the sign.

1274.02. Road Sign Installation, Location, and Visibility

(a) Road signs shall be visible and legible from both directions of vehicle travel for a distance of at least one hundred (100) feet.

(b) Signs required by this article identifying intersecting roads shall be placed at the intersection of those roads.

(c) A sign identifying traffic access or flow limitations, including but not limited to weight or vertical clearance limitations, dead-end roads, one-way roads, or single lane condition, shall be placed:

(1) at the intersection preceding the traffic access limitation, and

- (2) no more than one hundred (100) feet before such traffic access limitation.
- (d) Road signs required by this article shall be posted at the beginning of construction and shall be maintained thereafter.

1274.03. Addresses for Buildings

- (a) All buildings shall be issued an address by the local jurisdiction which conform to that jurisdiction's overall address system. Utility and miscellaneous Group U buildings are not required to have a separate address; however, each residential unit within a building shall be separately identified.
- (b) The size of letters, numbers, and symbols for addresses shall conform to the standards in the California Fire Code, California Code of Regulations title 24, part 9.
- (c) Addresses for residential buildings shall be reflectorized.

1274.04. Address Installation, Location, and Visibility

- (a) All buildings shall have a permanently posted address which shall be plainly legible and visible from the road fronting the property. Where access is by means of a private road and the address identification cannot be viewed from the public way, an unobstructed sign or other means shall be used so that the address is visible from the public way.
- (b) Address signs along one-way roads shall be visible from both directions.
- (c) Where multiple addresses are required at a single driveway, they shall be mounted on a single sign or post.
- (d) Where a road provides access solely to a single commercial or industrial business, the address sign shall be placed at the nearest road intersection providing access to that site, or otherwise posted to provide for unobstructed visibility from that intersection.
- (e) In all cases, the address shall be posted at the beginning of construction and shall be maintained thereafter.

Address numbers shall be Arabic numerals or alphabet letters, contrast with their background and be a minimum width of 0.5 inch and height per occupancy type as follows:

- **Residential** 6 inches
- **Commercial** 8 inches
- **Industrial** 10 inches

When a building is not visible from the roadway or when required by the Fire Chief, additional numbers or addresses shall be installed on an elevated post or monument adjacent to roads or driveways leading to buildings.

ARTICLE 4. EMERGENCY WATER STANDARDS

- § 1275.00. Intent
- § 1275.01. Application
- § 1275.02. Water Supply
- § 1275.03. Hydrant/Fire Valve
- § 1275.04. Signing of Water Sources

1275.00. Intent

Emergency water for wildfire protection shall be available, accessible, and maintained in quantities and locations specified in the statute and these regulations, in order to attack a wildfire or defend property from a wildfire.

1275.01. Application

The provisions of this article shall apply in the tentative and parcel map process when new parcels are approved by the local jurisdiction having authority.

1275.02. Water Supply

(a) When a water supply for structure defense is required to be installed, such protection shall be installed and made serviceable prior to and during the time of construction except when alternative methods of protection are provided and approved by the local authority having jurisdiction.

Water systems equaling or exceeding the California Fire Code, California Code of Regulations title 24, part 9, or, where a municipal-type water supply is unavailable, National Fire Protection Association (NFPA) 1142, "Standard on Water Supplies for Suburban and Rural Fire Fighting," 2017 Edition, hereby incorporated by reference, shall be accepted as meeting the requirements of this article.

(b) Such emergency water may be provided in a fire agency mobile water tender, or naturally occurring or man-made containment structure, as long as the specified quantity is immediately available.

(c) Nothing in this article prohibits the combined storage of emergency wildfire and structural firefighting water supplies unless so prohibited by local ordinance or specified by the local fire agency.

(d) Where freeze or crash protection is required by local jurisdictions having authority, such protection measures shall be provided.

1275.03. Hydrants and Fire Valves

(a) The hydrant or fire valve shall be eighteen (18) inches above the finished surface. Its location in relation to the road or driveway and to the building(s) or structure(s) it serves shall comply with California Fire Code, California Code of Regulation title 24, part 9, Chapter 5, and Appendix C.

(b) The hydrant head shall be a two and a half (2 ½) inch National Hose male thread with cap for pressure and gravity flow systems and four and a half (4 ½) inch for draft systems. Such hydrants shall be wet or dry barrel and have suitable freeze or crash protection as required by the local jurisdiction.

1275.04 Signing of Water Sources

Each hydrant/fire valve or access to water shall be identified as follows:

(a) If located along a driveway, a reflectorized blue marker, with a minimum dimension of three (3) inches shall be located on the driveway address sign and mounted on a fire retardant post, or

(b) If located along a street or road,

(1) a reflectorized blue marker, with a minimum dimension of three (3) inches, shall be mounted on a fire retardant post. The sign post shall be within three (3) feet of said

hydrant or fire valve, with the sign no less than three (3) feet no greater than five (5) feet

(2) above ground, in a horizontal position and visible from the driveway, or

(3) as specified in the State Fire Marshal's Guidelines for Fire Hydrant Markings Along State Highways and Freeways, May 1988.

ARTICLE 5. FUEL MODIFICATION STANDARDS

§ 1276.00. Intent

§ 1276.01. Setback for Structure Defensible Space

§ 1276.02. Maintenance of Defensible Space Measures

§ 1276.03. Disposal of Flammable Vegetation and Fuels

§ 1276.04. Greenbelts

1276.00 Intent

To reduce the intensity of a wildfire by reducing the volume and density of flammable vegetation, the strategic siting of fuel modification and greenbelt shall provide for increased safety for emergency fire equipment and evacuating civilians by its utilization around structures and roads, including driveways, and a point of attack or defense from a wildfire.

1276.01 Setback for Structure Defensible Space

(a) All parcels shall provide a minimum thirty (30) foot setback for all buildings from all property lines and/or the center of the road.

(b) When a thirty (30) foot setback is not possible for practical reasons, which may include but are not limited to parcel dimension or size, topographic limitations, or other easements, the local jurisdiction shall provide for same practical effect.

(1) Same practical effect requirements shall reduce the likelihood of home-to-home ignition.

(2) Same practical effect options may include, but are not limited to, noncombustible block walls or fences; five (5) feet of noncombustible material horizontally around the structure; installing hardscape landscaping or reducing exposed windows on the side of the structure with a less than thirty (30) foot setback; or additional structure hardening such as those required in the California Building Code, California Code of Regulations Title 24, part 2, Chapter 7A.

(c) Structures constructed in the SRA are required to comply with the defensible space regulations in Title 14. Natural Resources Division 1.5. Department of Forestry and Fire Protection Chapter 7. Fire protection Subchapter 3. Fire Hazard.

1276.02 Maintenance of Defensible Space Measures

To ensure continued maintenance of commonly owned properties in conformance with these standards and to assure continued availability, access, and utilization of the defensible space provided by these standards during a wildfire, provision for annual maintenance shall be provided in emergency access covenants or similar binding agreements.

1276.03 Disposal of Flammable Vegetation and Fuels

Disposal, including chipping, burying, burning or removal to a site approved by the local jurisdiction, of flammable vegetation and fuels caused by site development and

construction, road and driveway construction, and fuel modification shall be completed prior to completion of road construction or final inspection of a building permit.

1276.04 Greenbelts

Subdivision and other developments, which propose greenbelts as a part of the development plan, shall locate said greenbelts strategically, as a separation between wildland fuels and structures. The locations shall be approved by the local authority having jurisdiction and may be consistent with the CAL FIRE Unit Fire Management Plan or Contract County Fire Plan.

SECONDARY EGRESS REFERENCE STANDARD

Summary

This reference standard is intended to provide applicants with guidelines for project acceptance in regards to special events permits, wedding venues, winery events, general use permit applications, subdivision development, new construction applications, etc. Secondary egress can be an essential design aspect for projects where large gatherings or increased neighborhood density is proposed. Historical large scale fires have required residents/event attendees to egress rapidly. Fast moving wind driven wildfires have the ability to block single egress points. Existing roads which were previously approved for agricultural or residential use are not adequately designed to support fire crews and large numbers of private vehicles at the same time. Below are guidelines when secondary egress could be required. Each project will be reviewed based off existing conditions, vegetation models, proposed improvements, occupancy numbers and neighborhood density.

Code References

2019 CA Fire Code 503.1.2 Additional Access. The fire code official is authorized to require more than one fire apparatus access road based on the potential for impairment of a single road by vehicle congestion, condition of terrain, climactic conditions or other factors that could limit access.

2019 San Luis Obispo County Code Chapter 16. 503.1.2.1 Maximum Dead-end Road Lengths. The maximum length of dead-end roads, including all dead-end roads accessed from a dead-end road, shall not exceed the following cumulative lengths, regardless of the number of parcels served:

| Parcel size | Length |
|------------------------|-----------|
| less than one (1) acre | 800 feet |
| 1 acre to 4.99 acres | 1320 feet |
| 5 acres to 19.99 acres | 2640 feet |
| 20 acres or larger | 5280 feet |

All lengths shall be measured from the edge of the roadway surface at the intersection that begins from the road to the end of the road surface at its farthest point. Where a dead-end road crosses areas of differing zoned parcel sizes requiring different length limits, the shortest allowable length shall apply. Where parcels are zoned 5 acres or larger, turnarounds shall be provided at a maximum of 1320 feet or 1/4 mile intervals.

Lengths exceeding maximum dead-end road distances require secondary access as determined by the fire code official. Placement of roads shall be placed a distance apart equal to not less than one-half of the length of the maximum overall diagonal dimension of the property to be served, measured in a straight line between accesses

San Luis Obispo County Code 22.30.610 - Temporary Events. Access. (Inland Area)

Outdoor temporary events shall be provided a minimum of two unobstructed access points, each a minimum of 18 feet wide, from the event site to a publicly maintained road. Note: This requirement can be modified through a conditional use permit per San Luis Obispo County Code 22.30.020.D.

San Luis Obispo County Code 23.08.248 - Temporary Events. Access. (Coastal Zone)

Outdoor temporary events shall be provided a minimum of two unobstructed access points, each a minimum of 18 feet wide, from the event site to a publicly maintained road. Note: This requirement can be modified through a Development Plan per San Luis Obispo County Code 23.08.012(b)

Title 14 of the California Code of Regulations (14 CCR), Division 1.5, Chapter 7 & 2019

CFC D107 Secondary egress in residential areas. Development of more than thirty (30) residential units to include any building or portion thereof which contains living facilities, including provisions for sleeping, eating, cooking and/or sanitation, for one or more persons. Manufactured homes, mobile homes, and factory-built housing are considered residential units.

An adequate secondary egress route is a road, navigable by a passenger vehicle weighing 6,000 pounds or less. The secondary road does not have to be rated to carry the same quantity of traffic (e.g., a two-lane paved road and a one-lane paved road is acceptable).

An adequate secondary egress route is not:

- (A) a road with locked gates or limited access; or

(B) a road that directs traffic to the same outlet road as the primary road or results in a circular traffic flow, to the extent practicable.

Secondary egress route is required to meet road requirements established in San Luis Obispo County Code 22.54.020.

| Surface | Maximum Grade |
|--------------------------------|---------------|
| All Weather | Less than 12% |
| Non-skid (asphalt or concrete) | 12%-16% |
| Non-skid | Over 16% |

Process:

1. Does the project exceed the maximum dead-end road lengths requirement (503.1.2.1)?
 - **Yes** - Secondary egress is required
 - **No** – Secondary egress is not required, if criteria below is met, a minimum 20-foot-wide with 4 feet of shoulders is required for all commercial projects.

2. Project is located within a **Very-High severity zone**?
 - Maximum of 150 people on site (including employees). Over 150 occupancy secondary egress is required. Minimum 20-foot-wide road with 2 feet of shoulders is still required.

3. Project is located within a **High severity zone**?
 - Maximum of 250 people on site (including employees). Over 250 occupancy secondary egress is required. Minimum 20-foot-wide road with 2 feet of shoulders is still required.

4. Project is located within a **Moderate severity zone**?
 - Occupancy amounts will be site specific based on vegetation model/type of event/location to special hazards.

5. Requirements for all projects regardless of location.
 - Vegetation clearance, per PRC 4291 is required for all structures and roadways.
 - If several event sites are utilizing the same roadway on the same dates the road could be evaluated based off total traffic/evacuation.
 - Building and Fire Code requirements will be reviewed for all structures changing use or those which are associated with the project.

- Special circumstances may pertain to the project site and CFC 503.1.2 could still apply regardless of specific criteria being met. Allowable occupancies can be reduced based on site constraints.

Project required to meet all the criteria –

- (1) Maximum dead end length**
- (2) less than 30 units**
- (3) Occupancy based on location**

Fire Hazard severity zone identification map

https://osfm.fire.ca.gov/media/6795/fhszs_map40.pdf

04/2020